

Guidelines for the Evaluation and Repair of Residential Foundations

Version 3
(Adopted April 1, 2022)

**by the Texas Section of the
American Society of Civil Engineers**



Foreword to Version 3

The Texas Section of the American Society of Civil Engineers (ASCE Texas Section) adopted *Guidelines for Evaluation and Repair of Residential Foundations* on October 3, 2002, with an effective date of January 01, 2003. Version 2 was adopted on May 1, 2009. Version 3, presented herein, was adopted March 31, 2022. For reference, the following pages present specific changes to Version 2.

The Section began this work in 1999. This effort grew out of the response of many Section members to the Policy Advisory issued by the Texas Board of Professional Engineers (TBPE) in 1998, which addressed residential foundation engineering. Many ASCE practitioners expressed the opinion that technical guidelines should more rightly be created by a technical society such as ASCE rather than by the TBPE. One goal of the guidelines has been to provide the TBPE with guidance in their evaluation of complaints brought against engineers practicing residential foundation engineering.

One committee and two subcommittees were formed to address the raised concerns. One subcommittee addressed Recommended Practice for the Design of Residential Foundations (with their work presented in a separate document). The Guidelines for the Evaluation and Repair of Residential Foundations Subcommittee developed the attached document. The Residential Foundation Oversight (“Oversight”) Committee provided review guidance to the two previously mentioned subcommittees.

The Oversight Committee and both subcommittees were composed entirely of ASCE members who were licensed engineers. Subcommittee membership was open to any Texas Section member who wished to participate. Subcommittee formation and periodic progress updates were publicized at the Texas Section meetings and in the “Texas Civil Engineer” magazine. Publicity included invitations to any interested member of the Texas Section to serve on the subcommittees. The procedure for adopting Version 1 of this document included review and comment by the Oversight Committee followed by a period of time for public review and comment. The procedure for adopting subsequent versions of the documents also includes review and comment by the Oversight Committee. The dollar value of the professional services donated to the effort is conservatively estimated to exceed \$1,000,000.

The Guidelines are not intended to be Standards, but are guidelines only, reflecting the engineering opinions and practices of the committee members. They in no way replace the basic need for good engineering judgment based on appropriate education, experience, wisdom, and ethics in any particular engineering application. Thus, they are primarily suited as an aid for and use by engineers.

Members of the Foundation Evaluation and Repair Subcommittee (2019 through 2021):

Kenneth M. Struzyk, PE, Chair

Marshall B. Addison, PhD, PE
Gardner D. Atkinson, Jr. PhD, PE
David A. Belcher, PE
Gary W. Boyd, PE

John T. Bryant, PhD, PE
Brian C. Eubanks, PE
Sarah S. Hancock-Gamez, PE
Rene Gonzales, PE

Philip G. King, PE
Gary A Osborne, PE
Dean R. Read, PE
Mike Scanlon, PE

Members of the Residential Foundation Oversight Committee (2021):

Robert F. Pierry, Jr., PE, Chair

Ottis Foster, PE
Bob Gilbert, PhD, PE
Edmundo R. Gonzalez, Jr., PE
Rick Hale, PE
Philip King, PE

William D. Lawson, PE
Owen Sanderson, PE
Michael Skoller, PE
Kenneth Struzyk, PE
W. Tom Witherspoon, PhD, PE

The following lists the changes incorporated into Version 3:**Item 1. Section 1.5. Adopted Changes**

“In general, those interested in submitting changes for consideration by the Section should access the website at texasce.org and follow the instructions for submitting changes. Changes may also be submitted in writing to the Texas Section - ASCE, 3501 Manor Road, Austin, 78723, phone 512.472.8905, fax 512.472.2934”

Changed to

“In general, those interested in submitting changes for consideration by the Section should submit a written request to the Texas Section-ASCE, 1524 S. IH-35 Suite 180, Austin, TX, 78704, phone 512.472.8905, (please call for email instructions).”

Item 2. Section 3.1.2 Level B

“2. A drawing showing relative elevations.”

Changed to

“2. A scaled drawing showing relative elevations with a statement on the drawing or in the report regarding if differing thicknesses of floor covering were considered and how foundation areas with built-in slopes were addressed.”

Item 3. Section 3.1.2 Level B**Add**

“3. Report overall deflection, localized deflection, and tilt as compared to acceptable tolerances.”

Item 4. Section 3.1.2 Level B**Delete**

“1. Scaled drawings.”, and renumber remaining list.

Item 5. Section 5. EVALUATION CRITERIA, 5.2 Structural Integrity

“1. Cracks. Cracks may make concrete structural members weaker, although the majority of cracks do not compromise structural integrity.” The physical characteristics of the observed cracks should be considered when evaluating whether structural integrity has been compromised.

Changed to

“1. Cracks. Cracks may make concrete structural members weaker, although the majority of cracks do not compromise structural integrity. The physical characteristics of the observed cracks should be considered when evaluating whether structural integrity has been compromised.”

Item 6. Section 5. EVALUATION CRITERIA, 5.4 Deflection and Tilt

Change the entire 1st paragraph related to Original Construction Elevations (OCE) to “Foundations are generally constructed with surface elevation differences, but caution should be exercised when applying an assumed construction tolerance. Surveys performed soon after foundation construction and prior to initial closing are sometimes referred to as Original Construction Elevations (OCE). In addition, the engineer should consider the precision of the elevation measuring device used when reporting analysis results.”

Item 7. Section 5. EVALUATION CRITERIA

Sections titled, 5.4, Deflection and Tilt, 5.5 Overall Deflection, and 5.6 Localized Deflection were reorganized into the sections titled 5.4 Deflection and Tilt and 5.5 Overall Deflection; and the proceeding sections of the Section 5.0 were renumbered.

Item 8. Section 5. EVALUATION CRITERIA, 5.4 Deflection and Tilt

Add, Figure Nos. 1 and 2 which present local and overall deflection schematics, respectively.

Item 9. Section 5. EVALUATION CRITERIA, 5.4 Deflection and Tilt

Add the following paragraph, “When an OCE survey is available, the actual changes in elevation should be used for calculating the deflection ratio. These changes are determined by subtracting the current elevation at each point from the OCE survey elevation at the same point. Either the OCE survey or the current survey should be adjusted to reflect a common reference point, as well as for any differences in floor covering thicknesses. It is beneficial to take and record current elevations at approximately the same locations as the OCE survey, if possible. Additional location points can also be helpful, especially if significant elevation changes appear to have occurred. In the absence of an OCE survey, overall deflection, as defined below, may be more easily interpreted and evaluated than localized deflection. Localized deflection may be a more common occurrence.”

Item 10. Section 5. EVALUATION CRITERIA, 5.4 Deflection and Tilt

Remove 3rd paragraph from Section 5.5 and modify Section 5.4 to read,

“Foundations are generally constructed with surface elevation differences, but caution should be exercised when applying an assumed construction tolerance. Surveys performed soon after foundation construction and prior to initial closing are sometimes referred to as Original Construction Elevations (OCE). In addition, the engineer should consider the precision of the elevation measuring device used when reporting analysis results.

A single floor level survey yields the shape of the foundation at one instant and may or may not furnish sufficient information to support a conclusion. An evaluation may include an OCE survey and repeated floor level surveys performed over months or years. In such cases, the change in shape is measured between surveys. In addition, previous foundation repairs may change elevation shapes.

When an OCE survey is available, the actual changes in elevation should be used for calculating the deflection ratio. These changes are determined by subtracting the current elevation at each point from the OCE survey elevation at the same point. Either the OCE survey or the current survey should be adjusted to reflect a common reference point, as well as for any differences in floor covering thicknesses. It is beneficial to take and record current elevations at approximately the same locations as the OCE survey, if possible. Additional location points can also be helpful, especially if significant elevation changes appear to have occurred. However, overall deflection, as defined below, may be more easily interpreted, and evaluated than localized deflection. Localized deflection may be a more common occurrence.

A floor elevation survey can provide valuable information but should not be the only basis for evaluating foundation deflection and tilt. The engineer may use other indications of movement, such as those listed in Section 5.3, to estimate built-in floor unevenness when evaluating performance. Deflection may be more difficult to evaluate quantitatively than any other element of performance. Deflection is characterized by the deflection ratio, which is

defined as the maximum deviation of a third point from a straight line between two points divided by the distance (L) between the two points.

Foundation tilt is the planar variation from a level condition to one that slopes across the entire foundation. Tilt may be accompanied by deflection.”

Item 11. Section 5. EVALUATION CRITERIA, 5.5 Overall Deflection

Remove “Overall” from heading “Overall Deflection” resulting in “Section 5.5 Deflection”

Item 12. Section 5. EVALUATION CRITERIA, 5.5 Deflection

Change the first paragraph to read. “Overall deflection necessarily involves the overall foundation dimension in a given direction. Figure No. 1 depicts overall deflection. When additions have been made to a foundation, the overall foundation dimension should be considered for each separate foundation element and for the entire foundation. The amount of overall deflection is characterized by the deflection ratio.”

Item 13. Section 5. EVALUATION CRITERIA, 5.5 Deflection

Add a new paragraph after the four listed items to read, “The engineer should use other indications of movement to estimate built-in floor unevenness when evaluating deflection.”

Item 14. Section 5. EVALUATION CRITERIA, 5.5 Deflection (old Section 5.6 Localized Deflection)

Move the following paragraph from Section 5.5 to Section 5.4, “A single floor level survey yields the shape of the foundation at one instant and may or may not furnish sufficient information to support a conclusion. An evaluation may include an OCE survey and repeated floor level surveys performed over months or years. In such cases, the change in shape is measured between surveys. In addition, previous foundation repairs may change elevation shapes.”

Item 15. Section 5. EVALUATION CRITERIA, 5.5 Deflection (old Section 5.6 Localized Deflection)

Delete the heading, “Section 5.6 Localized Deflection” and renumber following sections.

Item 16. Section 5. EVALUATION CRITERIA, 5.5 Deflection

Add a last sentence to the last paragraph of the new numbered Section 5.5. Deflection Section to read, “The engineer should evaluate the significance of localized deflections and their consequences, but caution is advised when evaluating floor deviations over a distance less than approximately 20 feet because built-in unevenness can dominate.”

Item 17. Section 5. EVALUATION CRITERIA, 5.5 Deflection (old Section 5.6 Localized Deflection)

Modify wording to the following, “Localized deflection means a change from original profile or shape in an area smaller than the overall foundation. Figure No. 2 depicts localized deflection. Localized deflection manifests itself in similar ways as overall deflection. Localized deflection sometimes results in structural integrity or performance problems. The engineer should evaluate the significance of localized deflections and their consequences, but caution is advised when evaluating floor deviations over a distance less than approximately 20 feet because built-in unevenness can dominate.”

Item 18. Section 5. EVALUATION CRITERIA, 5.6 (old Section 5.7) Tilt

Change the reference to “the 1997 Uniform Code for Abatement of Dangerous Building” to “the 2006 International Existing Building Code”; and add the following paragraph after the first paragraph, “Foundation tilt may result in the floor slopes that affect comfortable or convenient use of the building. A tilt greater than 1 percent is usually noticeable. The Americans with Disabilities Act considers a 2 percent slope too large.”

Item 19. Section 7. REMEDIAL MEASURES, 7.3.1 Conscientious Water Program

Insert verbiage to make paragraph read, “The client should be informed that maintaining near uniform soil moisture conditions near all sides of the foundation may be beneficial. The Engineer may provide guidance regarding maintaining favorable soil moisture conditions which may include localized, concentrated or reduced watering. Caution should be advised against excessive watering.”

Item 20. Section 7. REMEDIAL MEASURES, 7.3.2 Vegetation Alteration

Insert verbiage to make the section read, “Trees or large shrubs near a foundation may cause soil shrinkage under the foundation. Removal of these trees or shrubs may stop shrinkage or lead to partial restoration of areas of downward foundation movement. Removal may result in upheaval caused by soil moisture increase, especially if the tree predates construction. If trees are removed, a suitable waiting period may be recommended to allow for soil heave.

Periodic tree pruning may reduce future downward foundation movement but may not lead to foundation elevation recovery. Tree pruning may be a prudent alternative to removal.”

Item 21. Section 7. REMEDIAL MEASURES, 7.3.3 Root Barriers

Change verbiage to make the section read, “Root barrier installation may negatively affect the vegetation and it is recommended to contact an experienced arborist for recommendations to minimize these affects.”

Item 22. Section 7. REMEDIAL MEASURES, 7.3.5.1 Surface Grading

Change verbiage from “first 5 feet” to “first 10 feet”.

Item 23. Section 7. REMEDIAL MEASURES, 7.3.5.4 Subsurface Water Drainage

Change verbiage from “slope of 0.5 percent to a surface outfall.” to “Provide a continuous slope of 2 percent if practicable, and 1 percent at a minimum.” And Change verbiage from “Downspouts should not be connected to perforated pipe subsurface drainage systems.” To “Downspouts and surface drains should not be connected to perforated pipe subsurface drainage systems.”

Item 24. Section 7. REMEDIAL MEASURES, 7.5.3 Additional Supports

Change verbiage to read, “Additional supports can be installed when beam or floor framing spans are too great for the actual loading conditions. Any added supports should be compatible with the original foundation support system.”

Item 25. Section 7. REMEDIAL MEASURES, 7.7 Floor Elevations

Change verbiage to read, “Floor elevation measurements, as described in Section 3.1.2 and 7.4.1 No. 11 above, should be made by the engineer, or the engineer’s authorized representative, after implementation of remedial measures. The engineer should keep a record of these elevation measurements and furnish a copy to the client.”

Table of Contents

Evaluation and Repair of Residential Foundations	1
By the Texas Section of the	1
American Society of Civil Engineers	1
Section 1. PURPOSE AND SCOPE.....	1
1.1 Introduction	1
1.2 Background	1
1.3 Objectives	1
1.4 Limitation.....	2
1.5 Adopted Changes.....	2
Section 2. QUALIFICATIONS OF THE ENGINEER.....	3
2.1 Professional Qualifications	3
2.2 Professional Ethics	3
Section 3. LEVELS OF INVESTIGATION	4
3.1 General	4
Section 4. EVALUATION METHODOLOGY	6
4.1 General	6
4.2 Analysis.....	6
Section 5. EVALUATION CRITERIA.....	7
5.1 General	7
5.2 Structural Integrity	7
5.3 Foundation Performance	8
5.4 Deflection and Tilt.....	8
5.5 Deflection	9
5.6 Tilt	12
5.7 Remediation Criteria.....	12
Section 6. REPORTING.....	13
Section 7. REMEDIAL MEASURES.....	14
7.1 Objectives and Limitations of the Remedial Measures.....	14
7.2 Responsibility of the Engineer	14
7.3 Non-structural Remedial Measures	14
7.4 Structural Remedial Measures	16
7.5 Repair of Pier and Beam Foundations.....	18
7.6 Post Lift Plumbing Testing.....	19
7.7 Floor Elevations.....	19
7.8 Compliance Letter	19

Guidelines for the Evaluation and Repair of Residential Foundations

**by the Texas Section of the
American Society of Civil Engineers**

Section 1. PURPOSE AND SCOPE

1.1 Introduction

The purpose of this document is to provide guidance for engineers practicing in the field of residential foundation evaluation and repair within the State of Texas with the goal of protecting the public when obtaining these services. The principal items discussed in this document are as follows:

1. An introduction presenting the background leading to the need for this document
2. Qualifications of engineers performing evaluations or repair designs
3. Scope of services
4. Methodology
5. Information typically presented in the evaluation report
6. Performance criteria for residential foundations
7. Foundation repair and remedial alternatives
8. Anticipated structure performance after remedial measures

1.2 Background

Texas has large areas with clayey soils that shrink and swell with changes in soil moisture content. This shrinking and swelling may cause movement of residential foundations that adversely affects the residence. Other factors may influence foundation performance. Some of these factors are inadequate design or construction, unanticipated loads, deterioration of materials, compressibility of the supporting soils, landscaping practices, leaking plumbing, and slope instability. The American Society of Civil Engineers, Texas Section (ASCE, TX) developed this document as a guideline for evaluation and repair of residential foundations. A separate document, *Recommended Practice for the Design of Residential Foundations*, also developed by ASCE, TX, addresses residential foundation design.

1.3 Objectives

The most common purpose of an engineering evaluation of a residential foundation is to assess its performance. This involves observation and evaluation of cosmetic (non-structural) distress and structural damage. The evaluation may also provide opinions of probable causes of distress or damage, assessment of risk of further damage,

recommendations for remedial measures, and cost estimates. If the evaluation determines that remedial measures are appropriate, the engineer may be asked to provide the design and construction documents.

1.4 Limitation

These guidelines have been developed by experienced professional engineers and presents practices they commonly employ to help deal effectively with soil conditions that historically have created problems for residential foundations in Texas. These guidelines presume the existence of certain standard conditions when, in fact, the combination of variables associated with any given project always is unique. Experienced engineering judgment is required to develop and implement a scope of service best suited to the variables involved. For that reason, the developers of this document have made an effort to make the document flexible. Thus, successful application of this document requires experienced engineering judgment; merely following the guidelines may not achieve a satisfactory result. Unless adherence to this document is made mandatory through force of law or by contractual reference, adherence to it shall be deemed voluntary. This document does not, of itself, comprise the standard of care which engineers are required to uphold.

1.5 Adopted Changes

The Texas Section of the American Society of Civil Engineers (ASCE) has adopted procedures for changing the guidelines. In general, those interested in submitting changes for consideration by the Section should submit a written request to the Texas Section-ASCE, 1524 S. IH-35 Suite 180, Austin, TX, 78704, phone 512-472-8905, (please call for email instructions). Anonymous changes will not be considered. Those submitting changes should include contact information, state why a change is proposed, include applicable calculations if appropriate, and provide alternative language to incorporate the change. The appropriate committee will consider the changes, and from time to time the Texas Section may adopt the changes and issue revised Guidelines.

Section 2. QUALIFICATIONS OF THE ENGINEER

2.1 Professional Qualifications

The evaluation and repair design shall be performed by a professional engineer licensed in the State of Texas. Engineers in responsible charge of this type of work must be competent to apply scientific and engineering education, training, knowledge, skill and experience to the investigation and analysis of constructed facilities. This determines the cause and extent of diminished performance and the means of remediation. Engineers should be competent in the related disciplines or should retain outside consultants as needed.

2.2 Professional Ethics

It is essential to avoid conflicts of interest to maintain the credibility of the evaluation investigation. The evaluating engineer must demonstrate qualities of character that will ensure impartiality. These qualities include objectivity, confidentiality, honesty and integrity.

ASCE members subscribe to the ASCE Code of Ethics, which includes the Fundamental Principles, Fundamental Canons, and Guidelines to Practice Under the Fundamental Canons of Ethics. Professional Conduct and Ethics comprise a sub chapter of the Texas Engineering Practice Act.

Section 3. LEVELS OF INVESTIGATION

3.1 General

The engineer should recommend an appropriate level of investigation to fulfill the objective of the evaluation. However, the scope of services shall be jointly established and agreed to by both the client and engineer. The engineer should personally visit the site and be in responsible charge of the investigative activities. If requested by the client, the engineer may only provide evaluation of reports by others, but this should be described as consultation, not investigation. For the purpose of aiding the client in determining the type of evaluation desired or actually performed, the following three levels of investigation are offered as guidelines.

3.1.1 Level A

This level of investigation shall be clearly identified as a report of first impressions and shall not imply that any higher level of investigation has been performed. This level of investigation will typically include, but is not restricted to:

1. Interview the occupant, owner, and client if possible, regarding a history of the property and performance of the structure
2. Request from the client and review the provided documents regarding the foundation, such as construction drawings, geotechnical reports, previous testing and inspection reports, and previous repair information
3. Make visual observations during a physical walk-through
4. Observe factors influencing the performance of the foundation
5. If requested by the client, provide a written report, containing at least the following:
 - a. scope of services
 - b. observations, site characteristics, and data deemed pertinent by the engineer
 - c. discussion of major factors influencing foundation performance and rationale in reaching conclusions concerning the subject residence
 - d. conclusions and any recommendations for further investigation or preventative measures

3.1.2 Level B

This level of investigation should include a written report including the items listed above for a Level A inspection and the following items:

1. A determination of relative foundation elevations, considering floor finishes, in sufficient detail to represent the shape of the foundation or floor adequately.
2. A scaled drawing showing relative elevations with a statement on the drawing or in the report regarding if differing thicknesses of floor covering were considered (and, if so, what adjustments were applied) and how foundation areas with built-in slopes were addressed. The scaled drawing should also show the axis along which deflection and tilt were calculated.
3. Report overall deflection, localized deflection, and tilt as compared to acceptable tolerances.

3.1.3 Level C

This level of investigation shall include the items listed above for Level A and Level B inspections and additional services, testing and related reports deemed appropriate by the Engineer. These may include, but are not limited to, the following:

1. Site specific soil sampling and testing
2. Plumbing testing
3. Material testing
4. Steel reinforcing survey
5. Post tensioning cable testing

This level of investigation should also include a more detailed level of reporting, which may include the following:

1. Description of factors that affect soil moisture
2. Observations of cut and fill
3. Tree survey
4. Photographs
5. Detailed distress survey

Section 4. EVALUATION METHODOLOGY

4.1 General

A rational method should be used to establish causes of distress or diminished performance, if any. A suggested method is summarized as follows:

1. Observe the structure, site conditions, other relevant phenomena, and collect pertinent data
2. Analyze the data
3. Formulate hypotheses
4. Test the hypotheses using analyses acceptable to the engineering profession along with engineering experience
5. Reach conclusions or reformulate the hypotheses

4.2 Analysis

Diminished performance of a structure may have several causes. The engineer should approach the analysis with an open mind. The analysis should follow a logical path to its conclusion. The evaluation should be quantitative to the extent practical but should not assume greater accuracy or precision than warranted by the data.

Section 5. EVALUATION CRITERIA

5.1 General

Residential foundations are expected to remain reasonably flat and level to provide acceptable performance. The criteria herein are intended to lend rationality and reasonable uniformity, supported by a consensus of practitioners, to the evaluation of performance and the need for repair of residential foundations.

The bases of these evaluation criteria are structural integrity and performance. Both may be affected by foundation deflection and tilt. Evaluations may be interpreted from the body of evidence or demonstrated by calculations.

5.2 Structural Integrity

Structural integrity considers the capability of the foundation to support its design loads as well as results and effects on other load bearing members of the superstructure. Elements of concern are stability, component strength and condition, and material soundness. In evaluating structural integrity, it should be understood that in many instances portions of the foundation and other structural components may not be available for observation.

Lack of structural integrity may be indicated by excessive deflection, cracking, partial collapse, loss of section, material deterioration, or demonstrated by calculations. If loss of structural integrity is demonstrated by calculations, the conclusion must be consistent with the physical evidence. Examples of lack of structural integrity include loss of shear capacity in concrete through excessive cracking, excessive tilt of structural elements such as posts or piers, unstable conditions in non load-bearing masonry, and rotting of wood structural members. The engineer should evaluate the following, if they are observed:

1. Cracks. Cracks may make concrete structural members weaker although the majority of cracks do not compromise structural integrity. The physical characteristics of the observed cracks should be considered when evaluating whether structural integrity has been compromised.”
2. Tilting of posts or piers above grade. Tilting can affect structural integrity or stability, although posts or piers above grade designed for eccentricity of load can tolerate some tilting without overstress. However, ordinary construction tolerances may result in vertical members being built out of plumb.
3. Tilt of masonry walls or veneer panels. Excessive tilt can lead to masonry collapse. Masonry veneer or infill is normally non load-bearing, and in some cases the veneer or infill may not be held in place except by its own weight. Tilt large enough to cause the weight vector (or center of gravity) to fall outside the middle third of bearing area is sufficient to cause tension in masonry walls or veneer.

4. Material deterioration. The strength of deteriorated material may raise a structural integrity issue. Evaluation of material deterioration may be based on observation, material sampling and testing, or non-destructive methods.

5.3 Foundation Performance

Foundation performance considers the capability of the building to serve its intended purpose. Elements of concern are safety, function, durability, and habitability. Inadequate foundation performance may result from inadequate strength or insufficient stiffness, and is shown in many ways. Visible indications may include:

1. Cracking or separating of exterior walls
2. Rotating, buckling, or deflecting masonry veneer panels
3. Cracking of concrete foundation elements
4. Cracking of gypsum board walls and ceilings
5. Separating of walls from ceilings or floors
6. Separating of rafters from a ridge board
7. Racking of door and window frames
8. Separating or racking of other structural framing
9. Cracking, buckling, or separating of floor coverings
10. Separating of initially tight joints
11. Deflecting or tilting of structural elements
12. Deteriorating materials

Observation of some of the listed conditions does not necessarily imply inadequate structural performance or insufficient stiffness. The importance of any of these indications may depend upon the age of the structure and any previous repairs.

5.4 Deflection and Tilt

Foundations are generally constructed with surface elevation differences, but caution should be exercised when applying an assumed construction tolerance. Surveys performed soon after foundation construction and prior to initial closing are sometimes referred to as Original Construction Elevations (OCE). In addition, the engineer should consider the precision of the elevation measuring device used when reporting analysis results.

A single floor level survey yields the shape of the foundation at one instant and may or may not furnish sufficient information to support a conclusion. An evaluation may include an OCE survey and repeated floor level surveys performed over months or years. In such cases, the change in shape is measured between surveys. In addition, previous foundation repairs may change elevation shapes.

When an OCE survey is available, the actual changes in elevation should be used for calculating the deflection ratio. These changes are determined by subtracting the current elevation at each point from the OCE survey elevation at the same point. Either the OCE

survey or the current survey should be adjusted to reflect a common reference point, as well as for any differences in floor covering thicknesses. It is beneficial to take and record current elevations at approximately the same locations as the OCE survey, if possible. Additional location points can also be helpful, especially if significant elevation changes appear to have occurred. However, overall deflection, as defined below, may be more easily interpreted and evaluated than localized deflection. Localized deflection may be a more common occurrence.

A floor elevation survey can provide valuable information but should not be the only basis for evaluating foundation deflection and tilt. The engineer may use other indications of movement, such as those listed in Section 5.3, to estimate built-in floor unevenness when evaluating performance. Deflection may be more difficult to evaluate quantitatively than any other element of performance. Deflection is characterized by the deflection ratio, which is defined as the maximum deviation of a third point from a straight line between two points divided by the distance (L) between the two points.

Foundation tilt is the planar variation from a level condition to one that slopes across the entire foundation. Tilt may be accompanied by deflection.

5.5 Deflection

Overall deflection necessarily involves the overall foundation dimension in a given direction. Figure No. 1 depicts overall deflection. When additions have been made to a foundation, the overall foundation dimension should be considered for each separate foundation element and for the entire foundation. The amount of overall deflection is characterized by the deflection ratio.

Building codes specify that structural members shall be designed to have adequate stiffness to limit deflections. The International Code Council International Residential CodeTM for One- and Two-Family Dwellings (IRC) specifies a maximum allowable live load deflection of any structural floor member of $L/360$, where L is the unsupported length of the member. This requirement typically is sufficient, in that in-service deflection will not result in excessive damage to cosmetic finishes, racking of door frames, or vibration. This deflection criterion may be appropriate for the analogous in-service deflection of a residential foundation, where for simplicity the entire foundation is considered as though it were a single structural member and differential soil movement is considered analogous to live load.

OVERALL DEFLECTION RATIO & TILT

DEFINITIONS:

DEFLECTION - THE MAXIMUM DEVIATION ("Δ") FROM A STRAIGHT LINE BETWEEN TWO POINTS.

DEFLECTION RATIO (ANGULAR DISTORTION) - THE DEVIATION FROM A STRAIGHT LINE BETWEEN TWO POINTS DIVIDED BY THE DISTANCE ("L") BETWEEN TWO POINTS.

OVERALL DEFLECTION RATIO - A DEFLECTION RATIO BASED ON THE OVERALL FOUNDATION DIMENSION IN A GIVEN DIRECTION.

TILT - THE PLANAR VARIATION FROM A LEVEL CONDITION TO ONE THAT SLOPES ACROSS THE ENTIRE FOUNDATION.

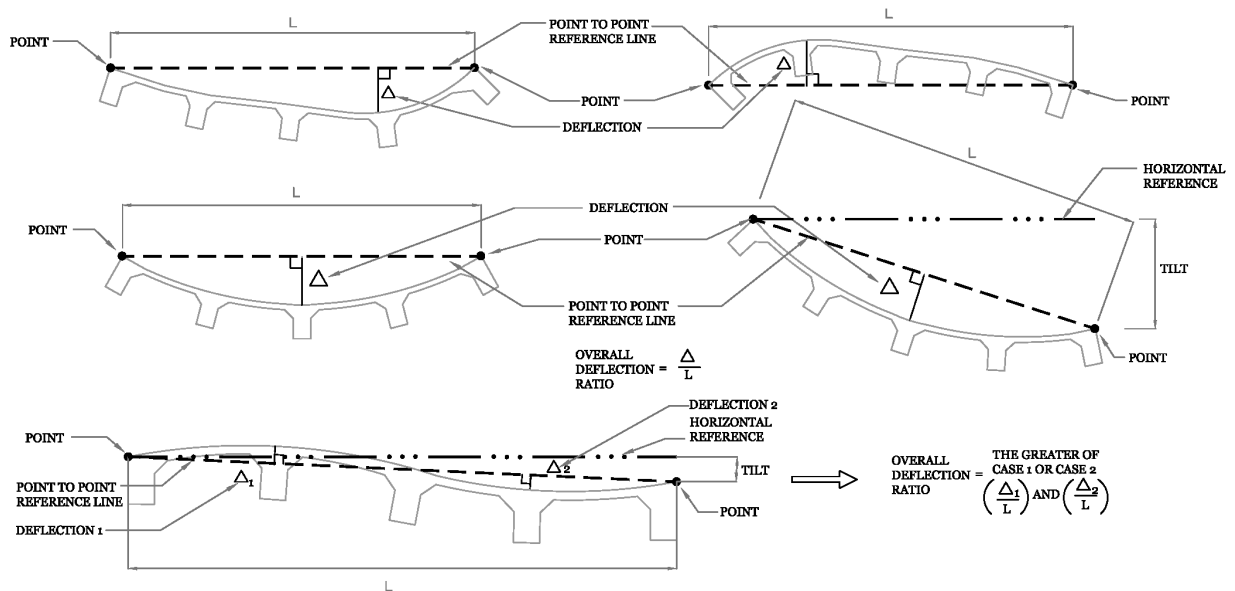


Figure 1

The engineer evaluating deflection must consider the floor level survey (Levels of Investigation B or C), and other indications of movement, such as:

1. Brick coursing not level.
2. Poor door alignment.
3. Levelness of built in horizontal surfaces, such as cabinets, countertops, sills and trim.
4. Cracking of exterior and interior wall finishes may indicate deflection, as do most items listed in 5.3 above.

The engineer should use other indications of movement to estimate built-in floor unevenness when evaluating deflection.

If a foundation profile indicates the deflection is less than the analogous deflection limit of $L/360$, it is unlikely the foundation is deflected materially unless visible indications show otherwise.

If a foundation profile indicates the deflection is more than the analogous deflection limit of $L/360$ and minimal symptoms of deflection are present, then additional information is needed by the engineer to develop a conclusion. The additional information may allow the engineer to determine whether or not the foundation has deflected excessively.

If a foundation profile indicates the deflection is more than the analogous deflection limit of $L/360$ and sufficient symptoms of deflection are present, then the engineer generally will be justified in determining that the foundation has deflected excessively.

Localized deflection means a change from original profile or shape in an area smaller than the overall foundation. Figure No. 2 depicts localized deflection. Localized deflection manifests itself in similar ways as overall deflection. Localized deflection sometimes results in structural integrity or performance problems. The engineer should evaluate the significance of localized deflections and their consequences, but caution is advised when evaluating floor deviations over a distance less than approximately 20 feet because built-in unevenness can dominate.

LOCALIZED DEFLECTION RATIO

DEFINITIONS:

DEFLECTION - IS THE MAXIMUM DEVIATION (" Δ ") FROM A STRAIGHT LINE BETWEEN TWO POINTS.

DEFLECTION RATIO (ANGULAR DISTORTION) - IS THE DEVIATION FROM A STRAIGHT LINE BETWEEN TWO POINTS DIVIDED BY THE DISTANCE (" L ") BETWEEN TWO POINTS.

LOCALIZED DEFLECTION RATIO - A DEFLECTION RATIO BASED ON A CHANGE IN THE PROFILE OR SHAPE IN AN AREA SMALLER THAN THE OVERALL FOUNDATION.

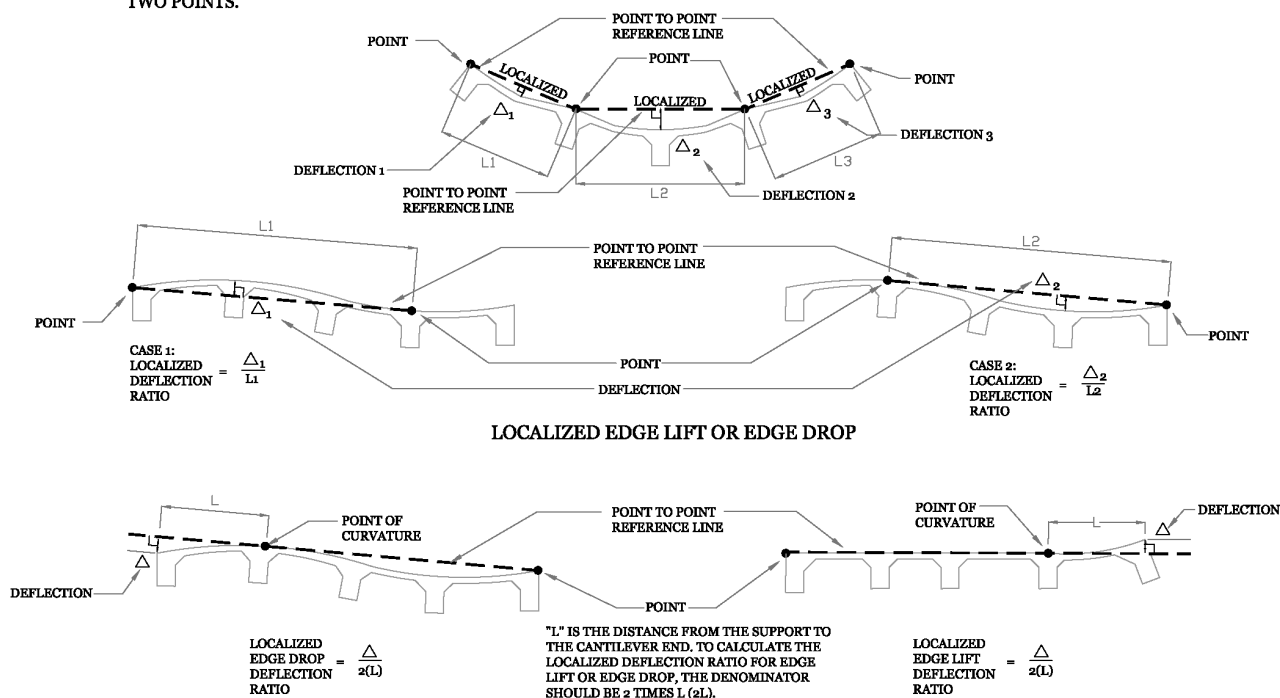


Figure 2

5.6 Tilt

Foundation tilt can affect structural integrity and performance. Tilt of entire foundations may be evaluated for structural integrity using the criterion stated for veneer panels, as discussed in Section 5.2 of this document. This criterion may be found in the 2006 International Existing Building Code.

Foundation tilt may result in floor slopes that affect comfortable or convenient use of the building. A tilt greater than 1 percent is usually noticeable. The Americans with Disabilities Act considers a 2 percent slope too large.

5.7 Remediation Criteria

If the residence is found to be unsafe due to structural inadequacies, the client and/or civil authorities should be informed immediately. The engineer should recommend repair, restoration, remediation, adjustment, or use alternatives if the structural integrity is inadequate. The engineer should provide alternatives for the client's consideration if performance is inadequate. Recommendations and alternatives should be commensurate with the nature and cause of the inadequacy, and the seriousness of its consequences.

The engineer should consider the cost effectiveness and practicality of the recommendations, the projected performance, and the needs of the client. For example, an owner may choose to perform periodic cosmetic repairs and door adjustments, rather than comprehensive foundation underpinning.

Risks of continued diminished performance are involved in all remedial measures. The engineer can, however, provide recommendations for remedial measures that reduce risks. Not implementing the entire remedial plan may increase such risks.

Section 6. REPORTING

The report provides a record of the investigation, analysis, and conclusions. Report formats may vary but should contain pertinent information that was obtained or generated during the investigation. The following list includes items that may be included in a report:

1. Authorization and Scope
2. Property Location and Description
3. Sources of Information
4. Data
5. Assumptions
6. Analysis of Information and Data
7. Conclusions
8. Recommendations
9. Limiting Conditions

Section 7. REMEDIAL MEASURES

7.1 Objectives and Limitations of the Remedial Measures

The objective of the engineer should be to design and recommend cost effective remedial measures. Remedial measures should address diminished structural integrity and performance identified during the evaluation process. Recommendations for remedial measures should include a clear description of what the remedial measures are intended to accomplish.

Perfection is not attainable by remedial measures. Recommendations for remedial measures should identify important or significant limitations of the measures and should comment on reasonable expectations of the remedial measures.

7.2 Responsibility of the Engineer

The engineer who provides sealed remediation documents or plans and specifications shall be the engineer of record and shall have approval authority over any changes. The Texas Engineering Practice Act And Rules Concerning The Practice of Engineering and Surveying, adopted by the Texas Board of Professional Engineers and Land Surveyors, prohibits the practice known as “plan stamping” by requiring that engineers seal only work done by them or under their direct supervision.

7.3 Non-structural Remedial Measures

Non-structural remedial measures may improve foundation performance and reduce future movement. Applying non-structural remedial measures and monitoring foundation performance prior to or in lieu of structural repairs may be a prudent approach. Typical recommendations for non-structural remedial measures may include, but are not limited to, the measures listed below.

7.3.1 Conscientious Watering Program

The client should be informed that maintaining near uniform soil moisture conditions near all sides of the foundation may be beneficial. The Engineer may provide guidance regarding maintaining favorable soil moisture conditions which may include localized, concentrated, or reduced watering. Caution should be advised against excessive watering.

7.3.2 Vegetation Alteration

Trees or large shrubs near a foundation may cause soil shrinkage under the foundation. Removal of these trees or shrubs may stop shrinkage or lead to partial restoration of areas of downward foundation movement. Removal may result in upheaval caused by soil moisture increase, especially if the tree predates

construction. If trees are removed, a suitable waiting period may be recommended to allow for soil heave.

Periodic tree pruning may reduce future downward foundation movement but may not lead to foundation elevation recovery. Tree pruning may be a prudent alternative to removal.

7.3.3 Root Barriers

Root barriers or periodic root pruning may mitigate the effects of vegetation. Root barrier installation may negatively affect the vegetation and it is recommended to contact an experienced arborist for recommendations to minimize these affects.

7.3.4 Gutters and Downspouts

Uncontrolled roof runoff can cause erosion and ponding of water near the structure, which can be mitigated by addition of gutters and downspouts. Downspouts should be extended well past the edge of the foundation, past the edge of abutting planting beds, and into well-drained areas.

7.3.5 Drainage Improvements

Drainage improvements may be appropriate to address foundation movement. If drainage improvements are considered, the following guidelines may be appropriate.

7.3.5.1 Surface Grading

Where practicable, for adjacent ground exposed or vegetative areas, a minimum slope of 5 percent (i.e. 6 inches in 10 feet) away from the foundation should be provided for the first 10 feet all around. Swales should have longitudinal slopes of at least 2 percent (i.e. 6 inches in 25 feet), if practicable, and 1 percent (i.e. 3 inches in 25 feet) at a minimum.

7.3.5.2 Erosion Control

The remedial documents should indicate locations where fill, ground cover or retaining structures are to be added.

7.3.5.3 Surface Water Drainage

When surface drainage cannot be improved adequately by grading, or when otherwise appropriate, solid pipe drainage systems should be specified. The ground surface should be graded to slope to one or more drainage inlets. Cleanouts should be provided for maintenance. Downspouts may be connected to solid pipe drainage systems, if the pipe is large enough for the hydraulic load of roof drainage.

7.3.5.4 Subsurface Water Drainage

Subsurface water drains are appropriate to control subsurface water, and usually consist of perforated pipe, with or without filter fabric, in an aggregate-filled trench. Provide a continuous minimum slope of 2 percent if practicable, and 1 percent at a minimum. Cleanouts should be provided for maintenance. Downspouts and surface drains should not be connected to perforated pipe subsurface drainage systems.

7.3.6 Moisture Barriers

Vertical or horizontal moisture barriers may be effective to mitigate moisture migration under the foundation. Moisture barriers may consist of durable impermeable plastic sheeting or other appropriate material attached to the foundation.

7.4 Structural Remedial Measures

Structural remedial measures may be necessary to improve foundation performance.

7.4.1 Structural Remedial Documents

The engineer should provide documents or plans and specifications that show specific details of the remedial measures. Plans should be specific for the project, and be based upon generally accepted engineering practice, including appropriate engineering calculations.

Remediation documents should include the following:

1. The site address
2. The engineer's name and the firm's name, address, and telephone number
3. The client's name and address
4. The purpose and limitations of the remedial measures
5. Available geotechnical information and source
6. A plan view of the foundation locating known relevant structural components
7. Details to show how to construct repair components
8. Specifications to identify appropriate materials and methods
9. Requirements for construction observation or testing by the engineer or others
10. Existing floor elevations or contours and elevation adjustment requirements, if appropriate
11. The requirement for performing a floor elevation survey after completion of the remedial measures
12. Site restoration requirements

7.4.2 Geotechnical Information

The engineer designing structural remedial measures will need geotechnical information. In some cases, geotechnical information may be derived from successful local practice, or other experience, verified during construction. For major or comprehensive remedial measures, geotechnical information should be derived from a site specific boring and testing program tailored to the project's needs.

7.4.3 Repair of Slab Foundations

Concrete slab-on-ground foundation repair methods include, but are not limited to: underpinning, grouting, mudjacking, crack injecting, tendon stressing, and partial demolition and reconstruction.

7.4.3.1 Underpinning

The plans should show or specify specific locations of underpinning elements and their sizes, depths, material types, and minimum required material strengths if appropriate. Underpinning design shall be based upon generally accepted engineering practice and appropriate engineering calculations. Performance of underpinning can be compromised by integrity of existing slab components, changes in soil moisture, skin friction, point load, and other factors.

Underpinning part of a structure may be specified if calculations, tests, or experience show that the unsupported structure can support its design loads. The construction documents should state that underpinning will not improve the performance of the foundation in non-underpinned areas.

Elevation adjustments by jacking or lifting atop underpinning elements may be applicable when floor slopes are excessive, or when the design requires that the foundation be lifted clear of expansive soil. Elevation adjustments should be governed by field judgment to limit damage to the foundation and finishes. It is unlikely that elevation adjustments will result in a level foundation.

7.4.3.2 Grouting and Mudjacking

In general, grouting provides continuous slab support without lifting appreciably. Mudjacking is done to adjust elevations of a foundation hydraulically with continuous uniform support. Grouting or mudjacking may be accomplished with temporary support atop shallow footings or long-term support atop deep piles or piers. Grouting or mudjacking should not be

performed beneath underpinned foundations if expected swelling of the soil in the injected area is sufficient to damage the structure.

7.4.3.3 Crack Injecting

Injecting slab cracks of about 1/32 inch and larger with epoxy repair cement is intended to restore stiffness across the injected crack. If the objective of the repair is solely to limit moisture intrusion or insect ingress, then alternative materials, such as sealants, may be appropriate.

7.4.3.4 Tendon Stressing

Stressing relaxed or inadequately stressed post-tensioned tendons may be applicable when tests show tendon forces below those specified in the original design or by applicable authority. Stressing may restore the residual prestress in the concrete, and should be performed after elevation adjustments and epoxy crack injecting, if any.

7.5 Repair of Pier and Beam Foundations

Pier and beam foundations consist of structurally supported floor systems atop piers, posts or footings. Repairs may include shimming the floor framing atop the existing supports, repairing or strengthening the floor framing, replacing or adding supports, and re-establishing void space.

7.5.1 Floor Shimming

Floor framing may be adjusted by addition of shims atop pier caps. Hardwood or steel shims may be used to fill gaps.

7.5.2 Framing Repairs

Structural members that are damaged or distressed should be replaced or reinforced. Treated lumber is recommended for general use in framing repairs.

7.5.3 Additional Supports

Additional supports can be installed when beam or floor framing spans are too great for the actual loading conditions. Any added supports should be compatible with the original foundation support system.

7.5.4 Void Space

Void spaces designed under foundation elements should be reestablished as necessary.

7.5.5 Under-Floor Crawl Space Moisture Control

Under-floor moisture control measures include crawl space cross ventilation, under-floor drainage, floor beam and floor joist ground clearance, and treated lumber.

7.6 Post Lift Plumbing Testing

Water supply and sanitary drain lines should be tested for leaks if jacking or lifting is included in the remedial measures. Gas service lines may require adjustment. Leaks found by such testing should be repaired.

7.7 Floor Elevations

Floor elevation measurements, as described in Section 3.1.2 and 7.4.1 No. 11 above, should be made by the engineer, or the engineer's authorized representative, after implementation of remedial measures. The engineer should keep a record of these elevation measurements and furnish a copy to the client.

7.8 Compliance Letter

Upon satisfactory completion of the remedial measures, the engineer, if retained to do so, should provide a letter of substantial completion to the client stating that to the best of the engineer's knowledge, the remedial measures generally conform to the remediation documents, including approved changes. Deviations from the remediation documents should be noted in the letter.